KEYED NOTES:

1. ADULT PROBATION LEASE SPACE
2. EXISTING RTU TO BE REPLACED AS PART OF ADULT PROBATION RENOVATION.
3. EXISTING RTU TO BE REPLACED UNDER BASE BID. EXISTING RTU TO REMAIN UNDER DEDUCT ALTERNATE#2.
4. CONTRACTOR SHALL PROVIDE HURRICANE BRACING FOR ALL NEW RTUS.
5. ALL ROOF PENETRATIONS SHALL BE COORDINATED WITH DURO-LAST ROOF INSTALLER "JACO" SO THAT ROOF WARRANTY IS NOT VOIDED. CONTRACTOR SHALL INCLUDE ALL COST ASSOCIATED WITH COORDINATION AND PENTRATIONS IN BID.
6. NEW ROOF TOP UNITS SHALL BE SAME TONNAGE, CFM, SAME OUTSIED AIR, AND SAME ELECTRIC HEAT AS EXISTING UNITS TO BE REMOVED.
7. THE MECHANICAL CONTRACTOR SHALL SECURE AND PAY FOR ALL REQUIRED PERMITS AND FEES.
8. MECHANICAL CONTRACOTR SHALL RE-BALANCE AIR AND AIR BALANCE REPORT SHALL BE PROVIDED BY A CERTIFIED AIR BALANCER.
9. EXISTING 5 TON UNITS PACKAGE UNITS TO BE REPLACED UNDER BASE BID.

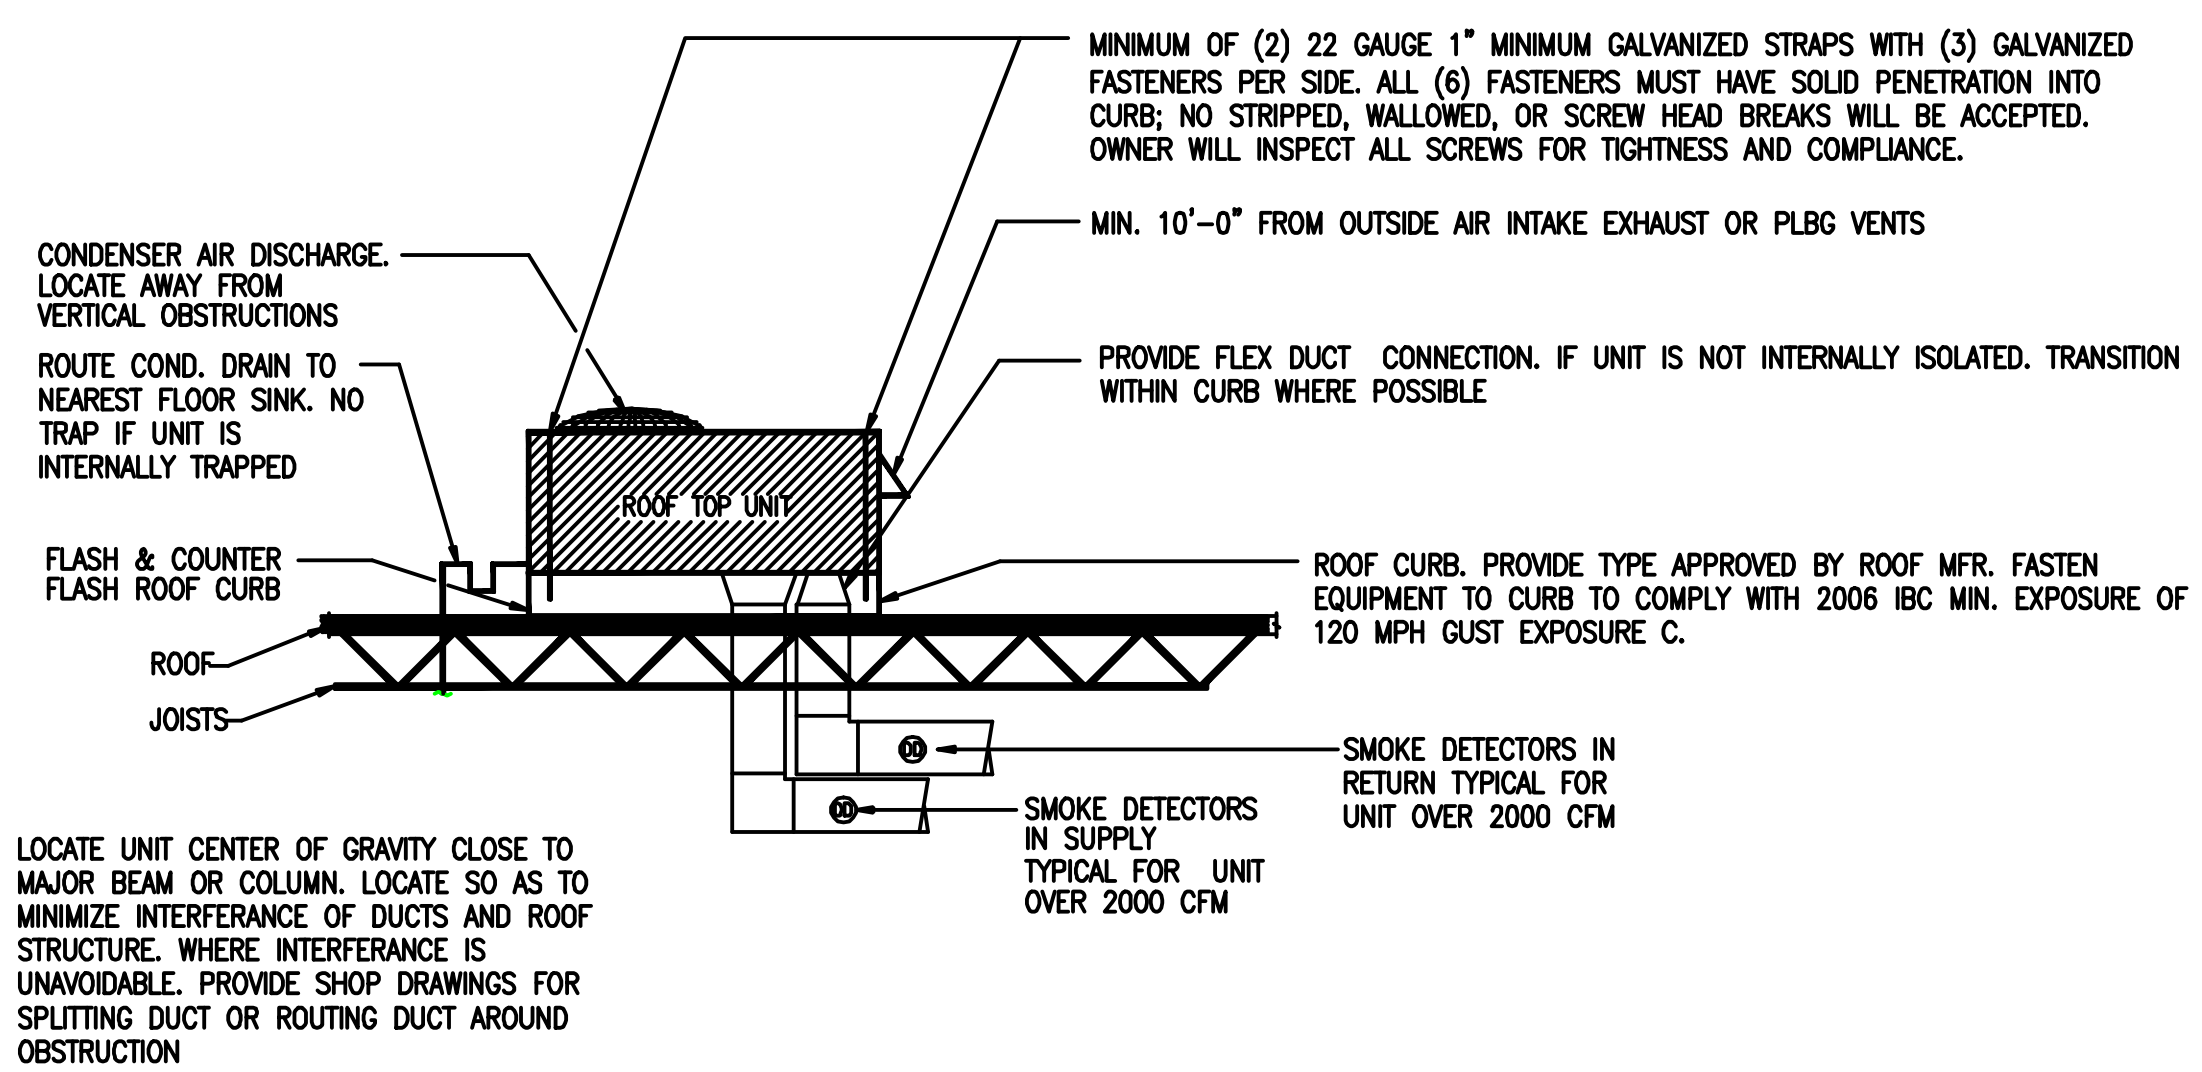
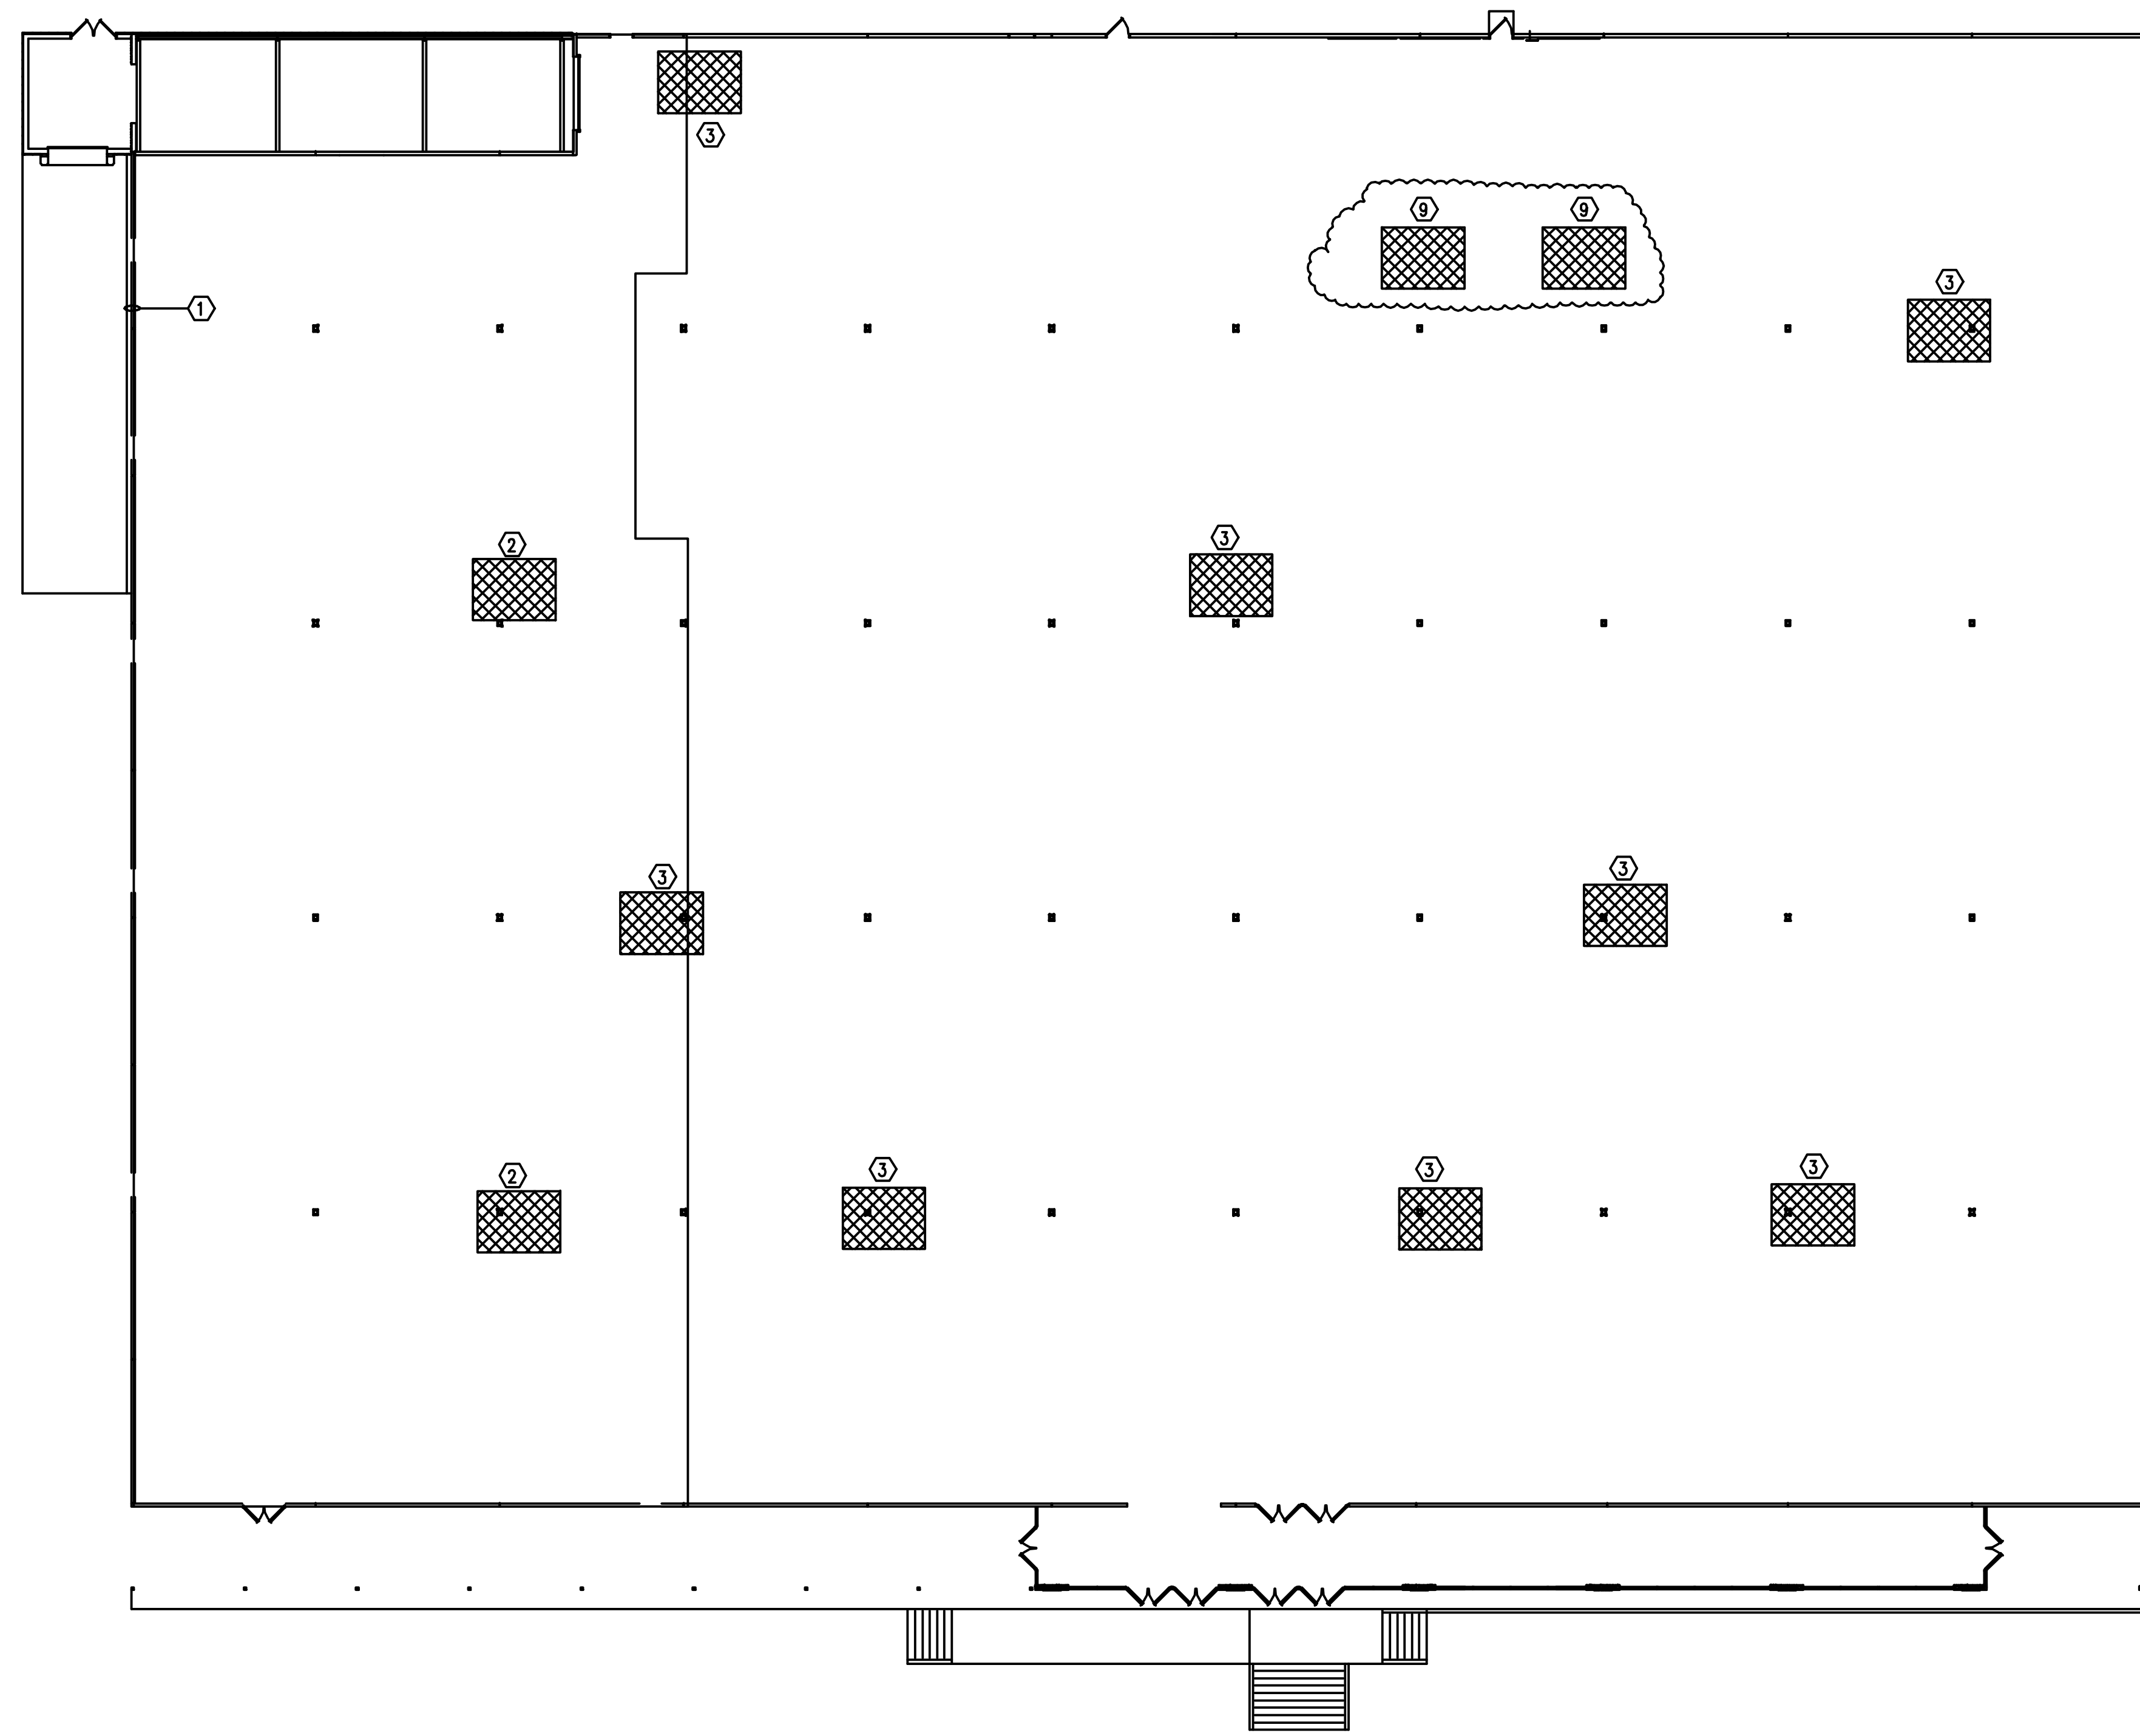
02 RTU INSTALLATION DETAIL
NTS